


riscaldamento

heating

02/09/2009



motive

Tipo motore : 100LB-8


V Nom. [V] : 400

Frequenza [Hz] : 50

P Nom.[KW] : 1,1

Giri [min⁻¹] : 715

File Prova : C:\Elektro\Prove\Trifase\100\ 100LB-8 B3 090610165 02SET09.TXT

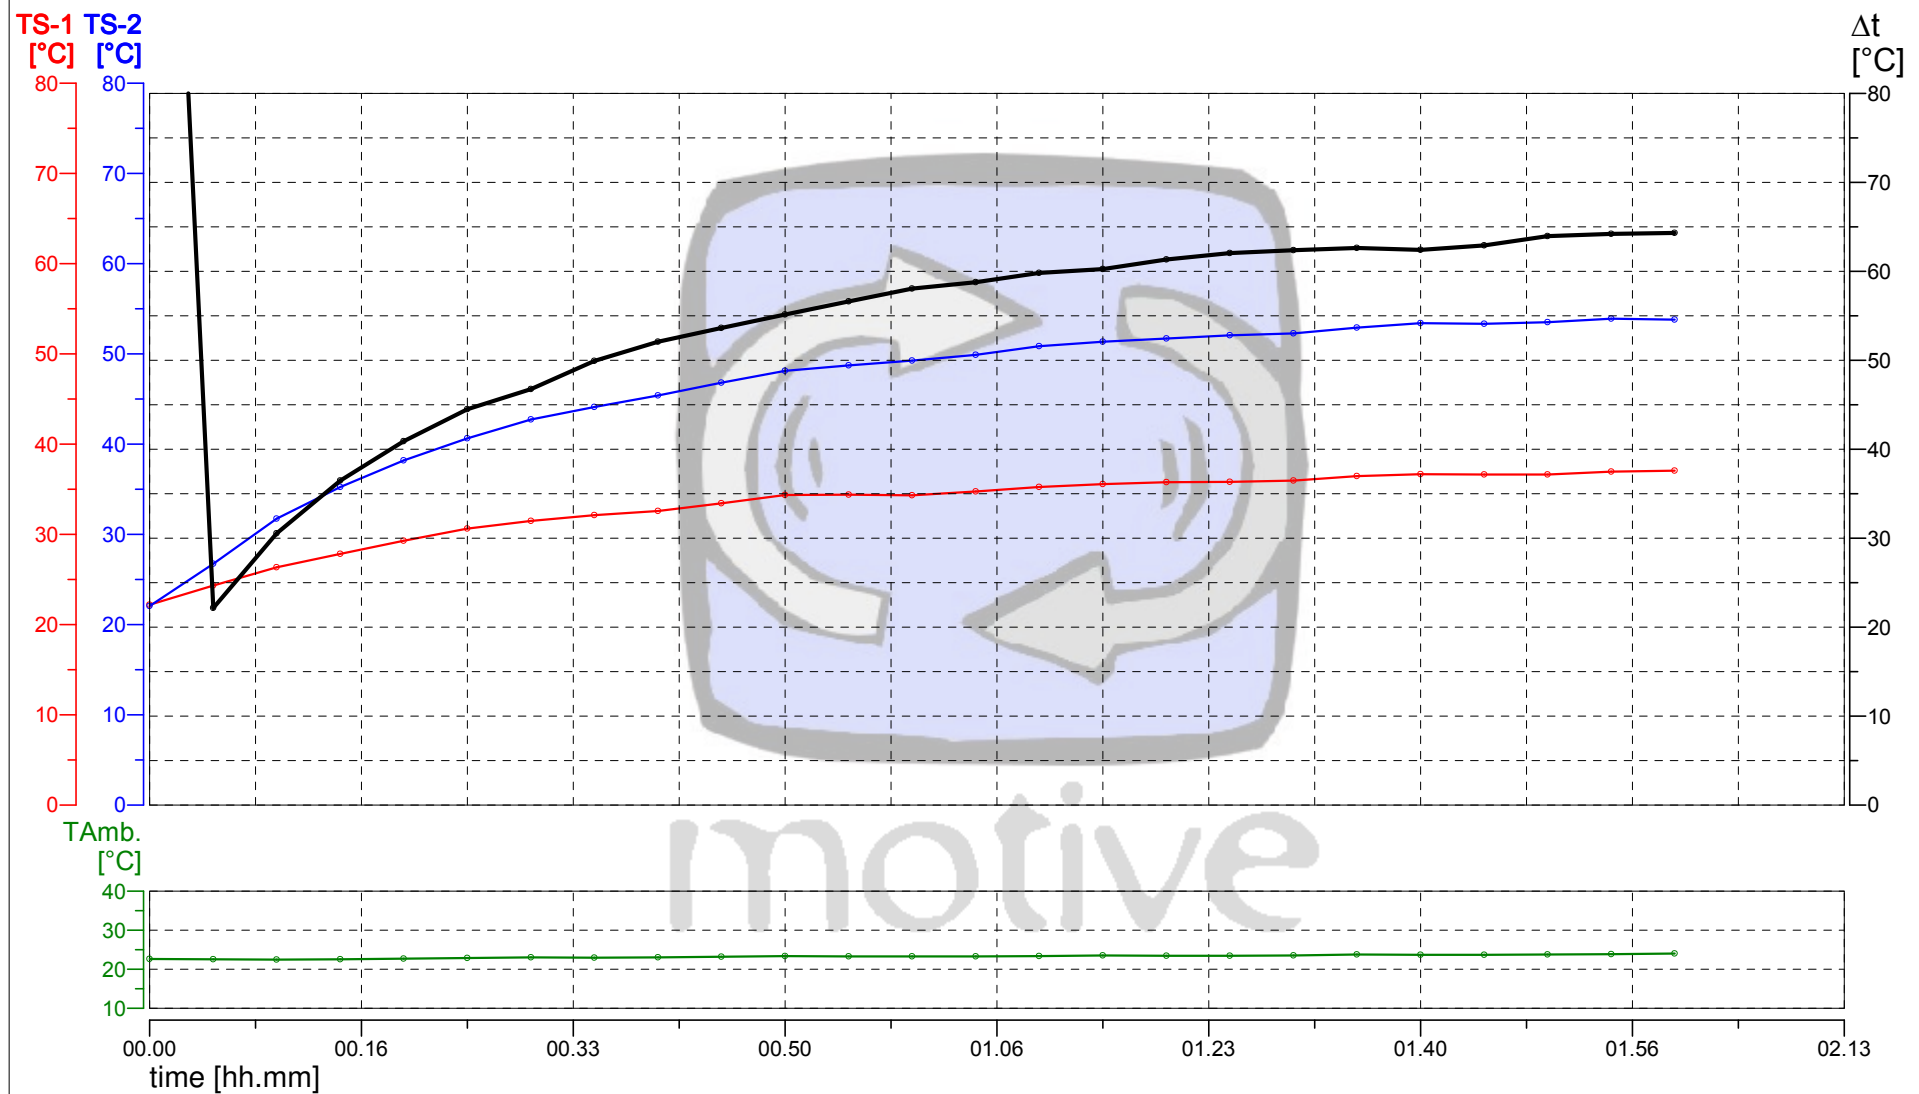

Note : PROVA MOTORE