

riscaldamento

28/01/2009

heating

Tipo motore : 90L-2


V Nom. [V] : 400

Frequenza [Hz] : 50


P Nom.[KW] : 2,2

Giri [min.⁻¹] : 2805

File Prova : C:\Elektro\Prove\Trifase\90\ 90L-2 B3 (G) 0809G01004 28GEN09.TXT



motive

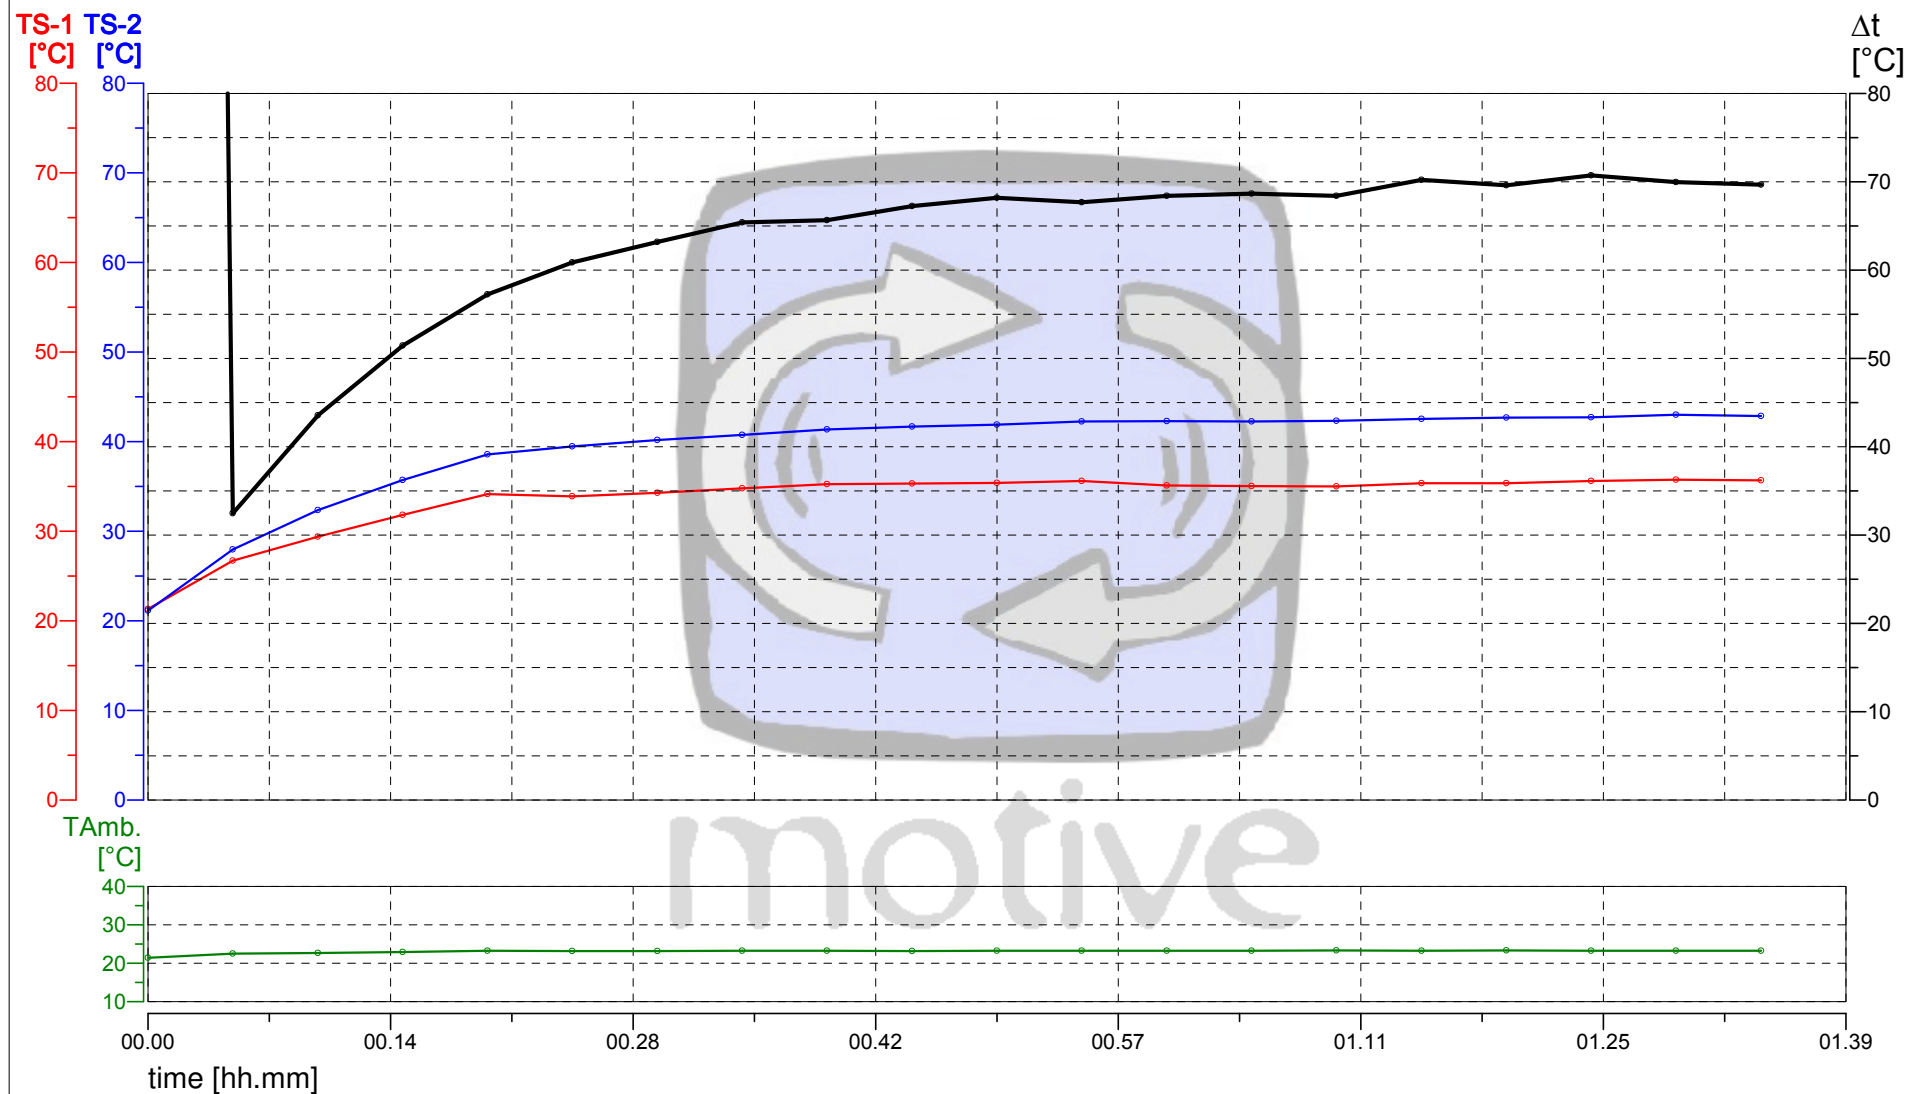

Note : Note: PROVA MOTORE (G)